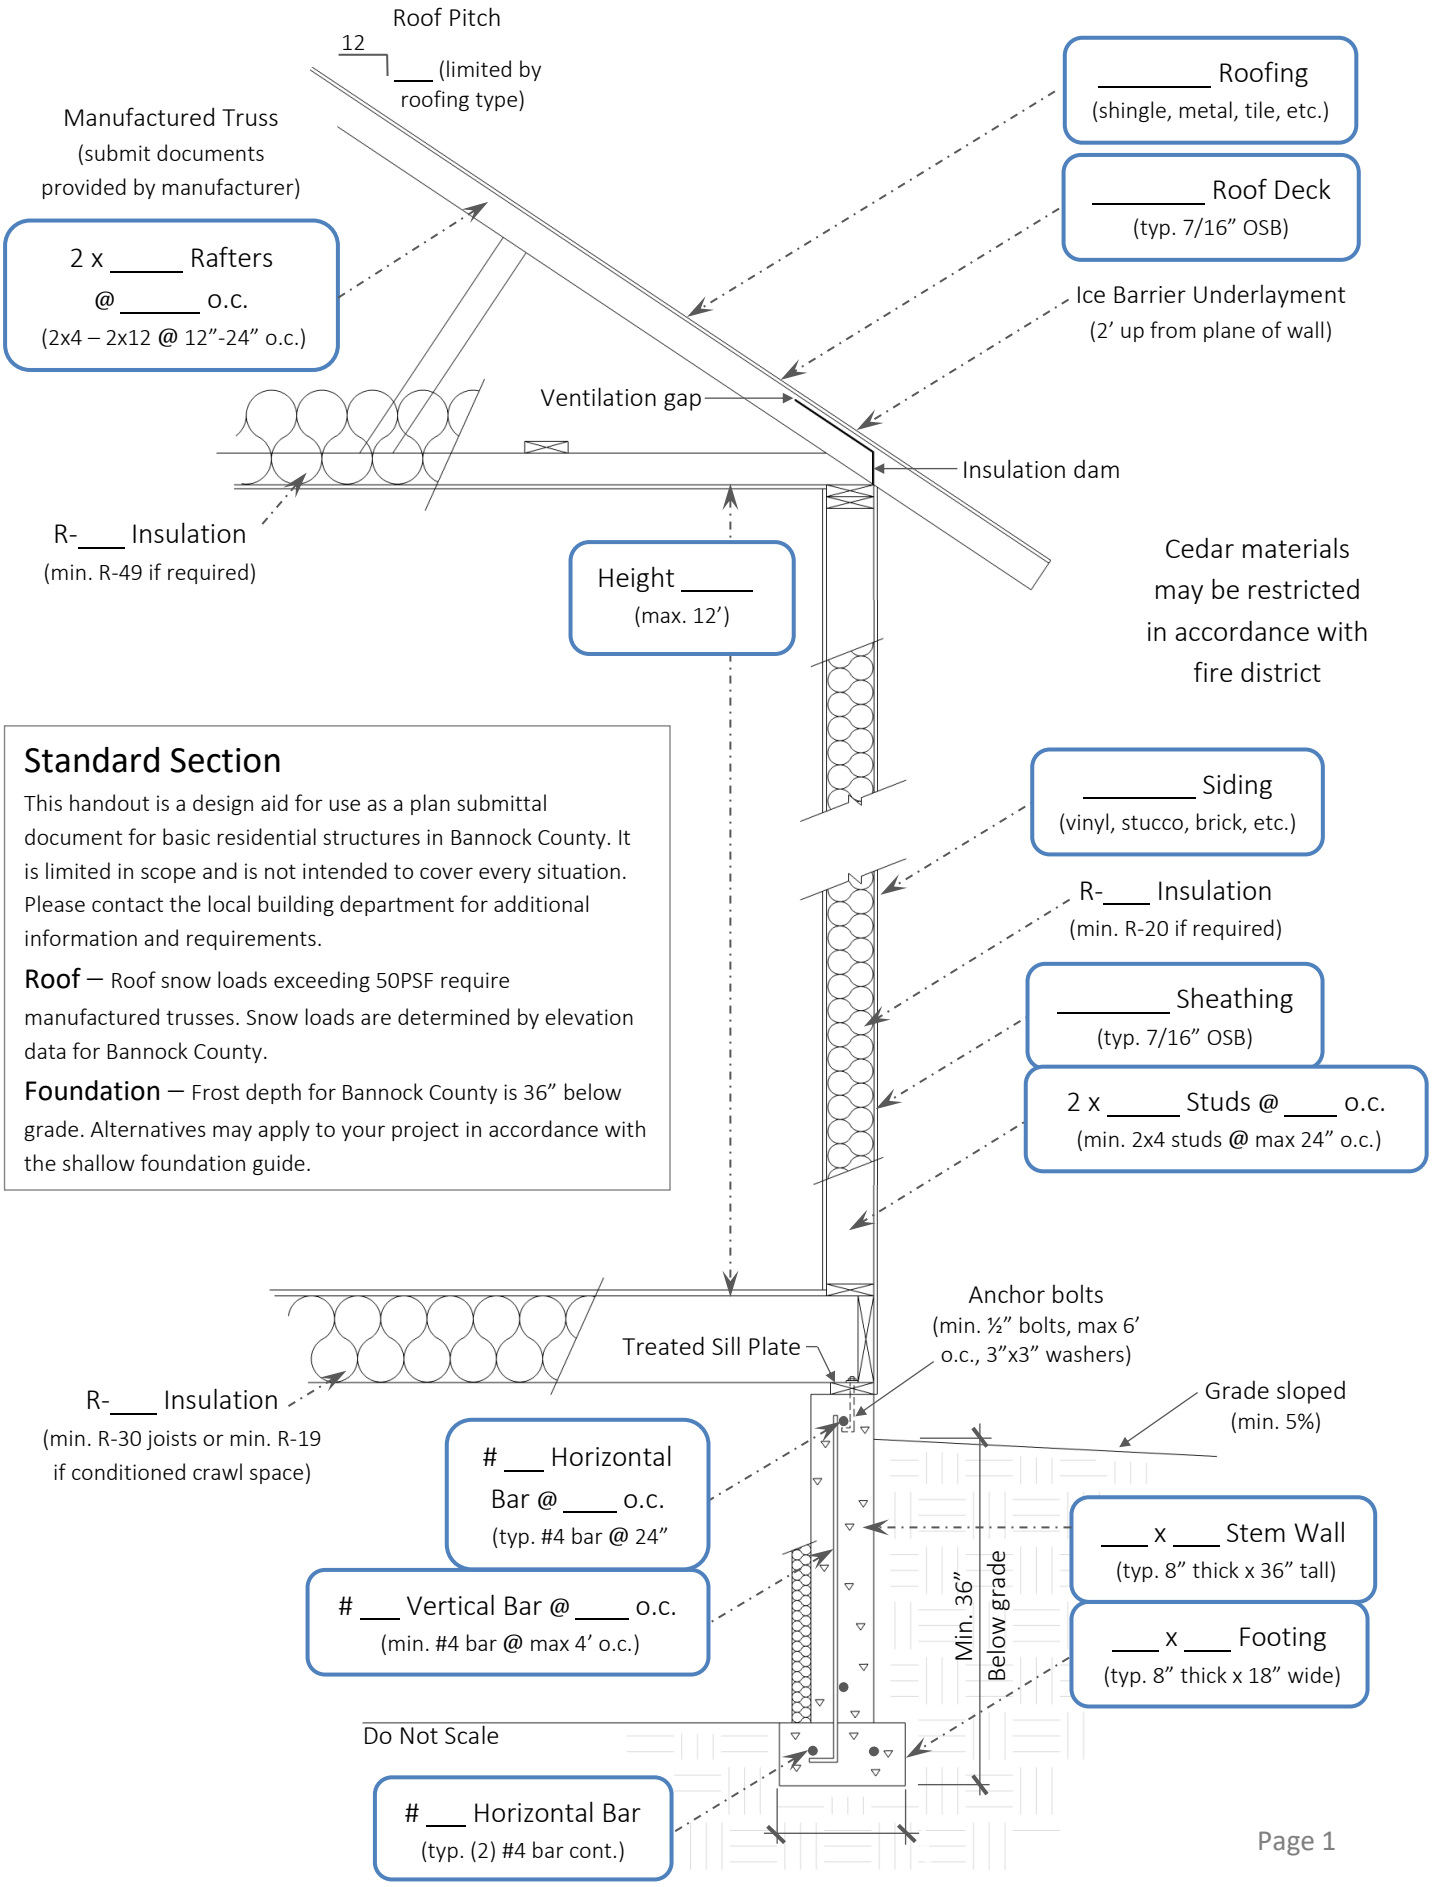

Standard Section

This handout is a design aid for use as a plan submittal document for basic residential structures in Bannock County. It is limited in scope and is not intended to cover every situation. Please contact the local building department for additional information and requirements.

Roof – Roof snow loads exceeding 50PSF require manufactured trusses. Snow loads are determined by elevation data for Bannock County.

Foundation – Frost depth for Bannock County is 36” below grade. Alternatives may apply to your project in accordance with the shallow foundation guide.